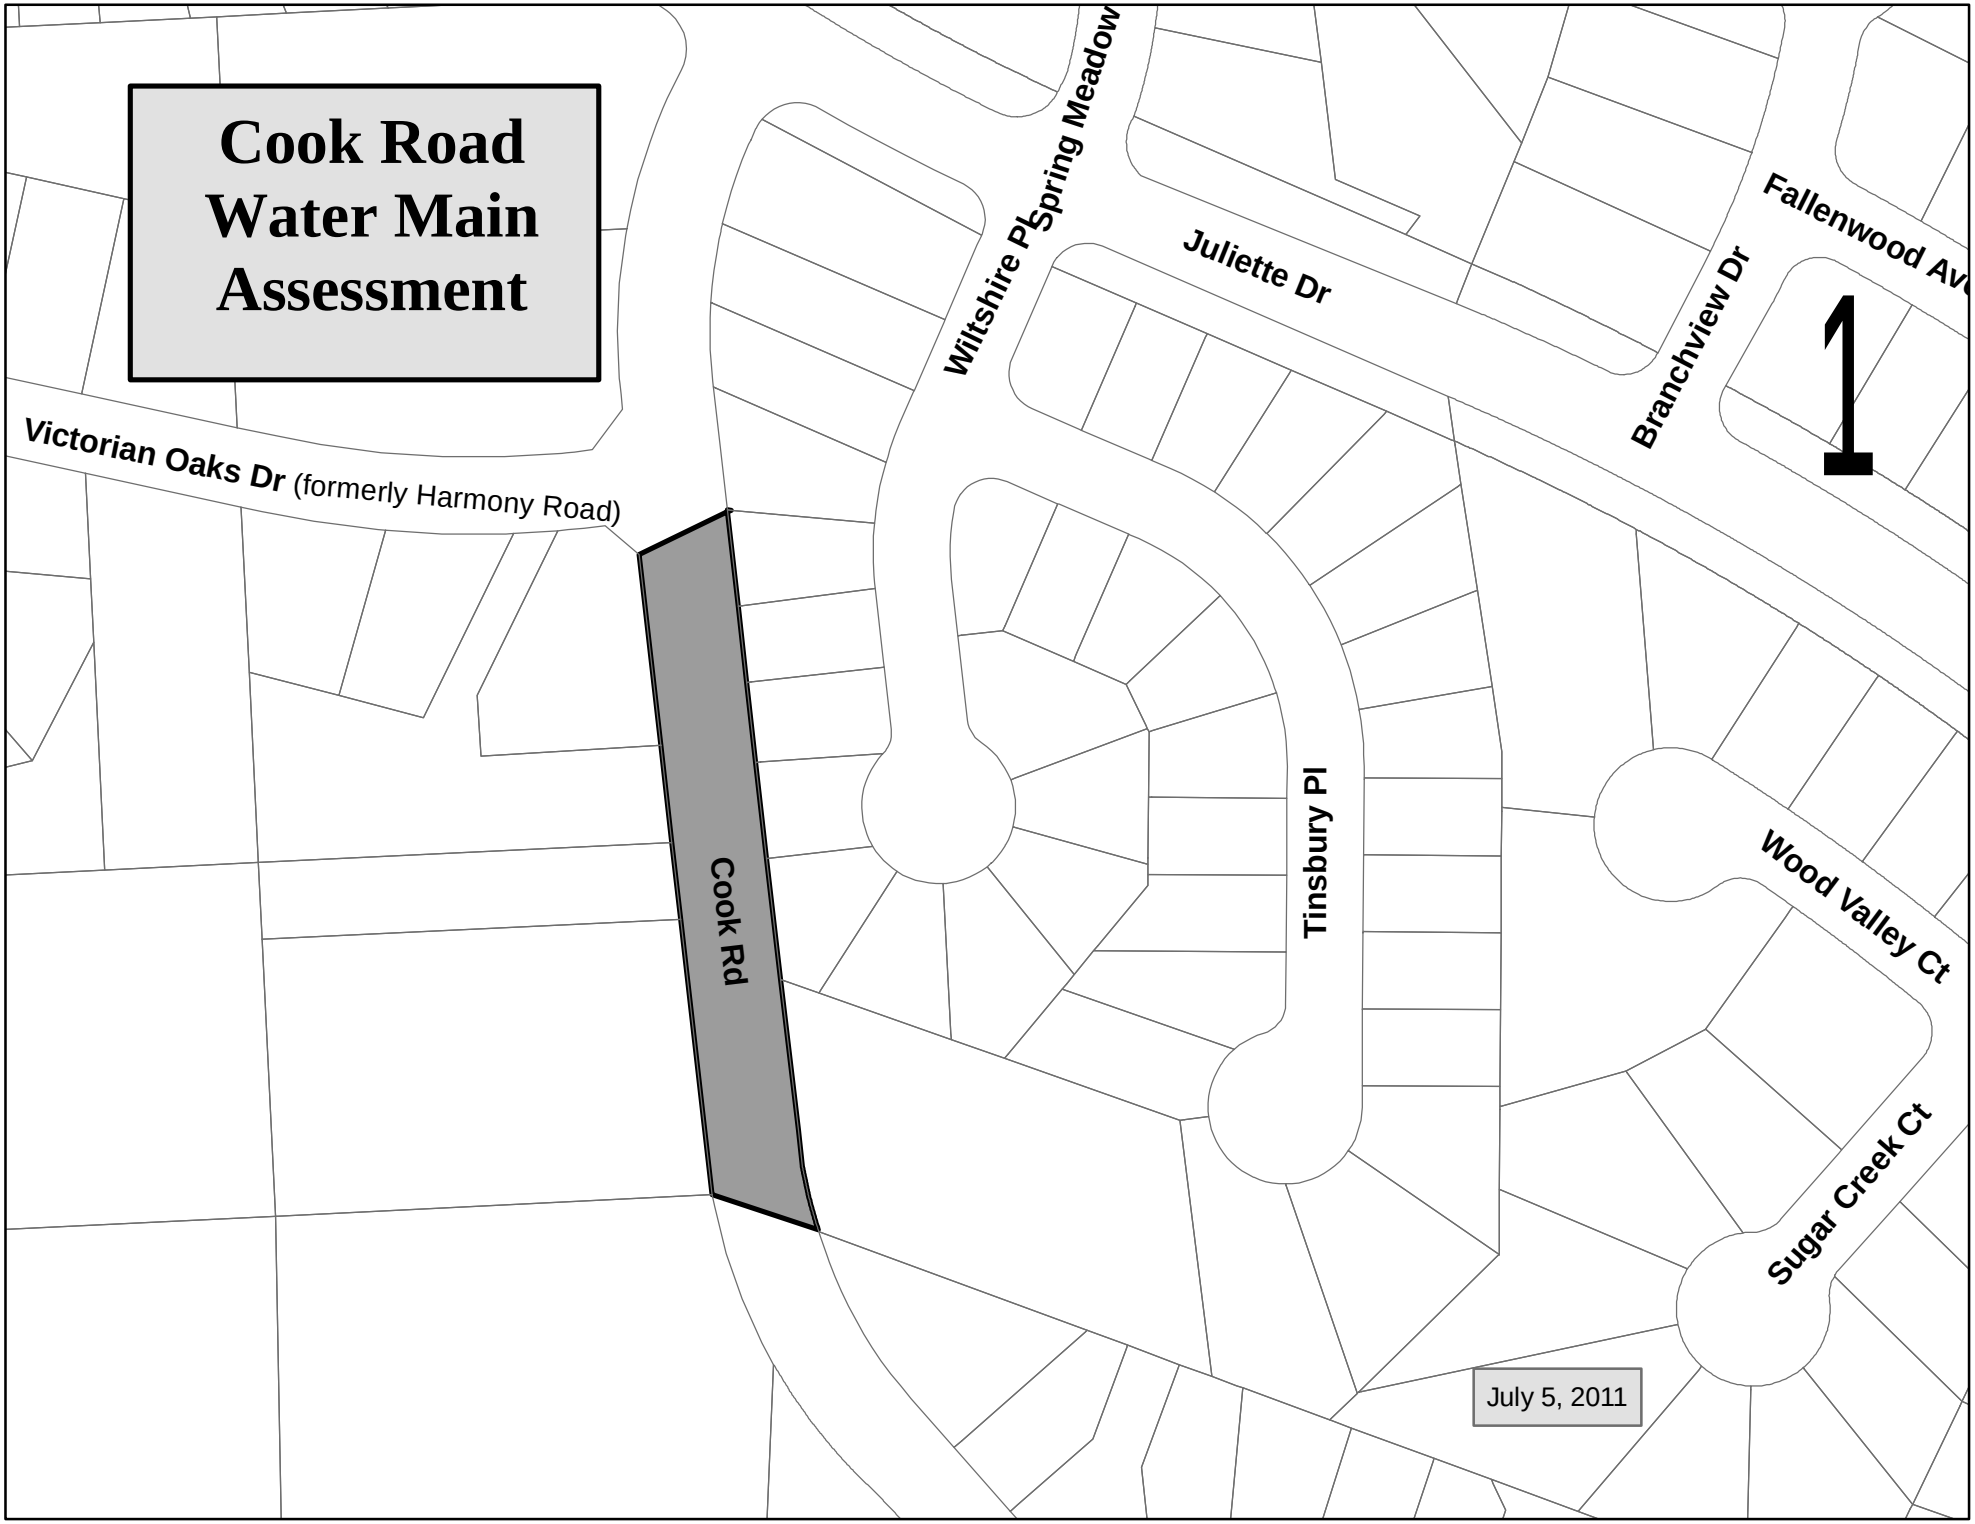Cook Road Water Main Assessment