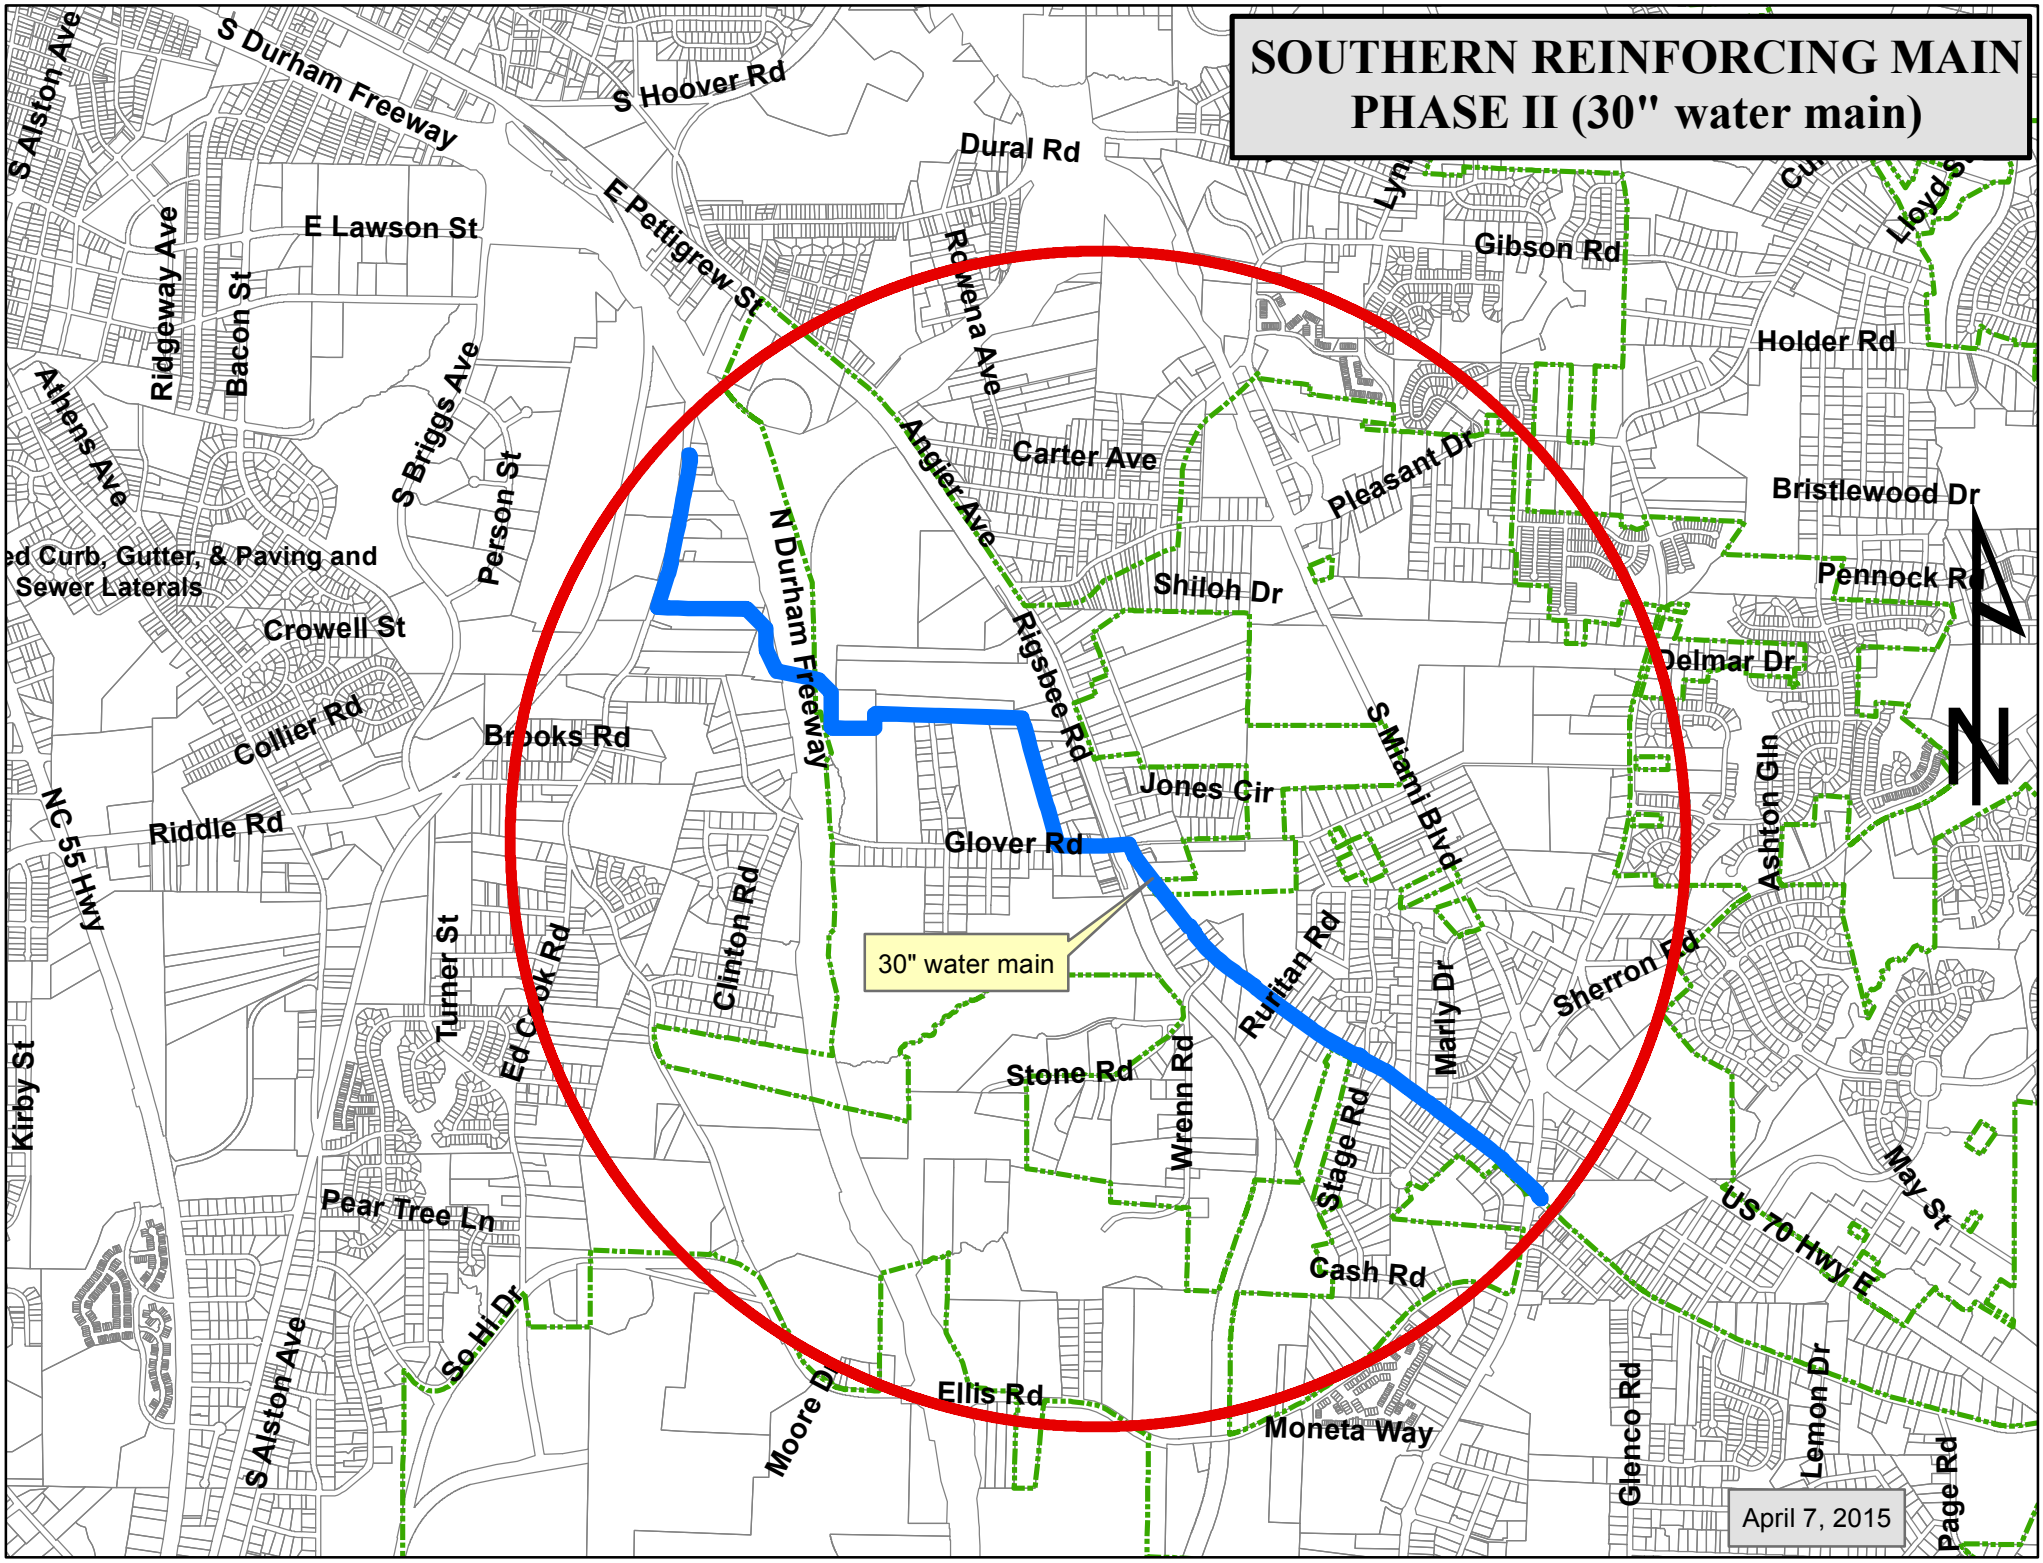SOUTHERN REINFORCING MAIN PHASE II (30" water main)