

DURHAM



1869
CITY OF MEDICINE

CITY OF DURHAM
DEPARTMENT OF PUBLIC WORKS
101 CITY HALL PLAZA • DURHAM, NC 27701
919.560.4326 • fax 919.560.4316
www.durhamnc.gov

- Engineering
- Stormwater Services
- Street Maintenance
- Transportation

September 25, 2008

MEMO TO: Prospective Bidders

SUBJECT: **Addendum No. 5**
City of Durham Contract SW-22:
2008 Apex Street Ramp Construction & Bridge Removal

This addendum provides clarification of the construction of an estimated 600 square feet of retaining wall. Please make these changes and add these instructions to the original proposal when submitting your bid.

Bid Item #23 Retaining Wall

Please note that the estimated 600 square feet of retaining wall shall be a modular design of keystone or equivalent style. Please see attached detail and adjust your bid, if needed, with this clarification in mind.

Please staple this addendum inside the front cover of the specifications, initial, and date the acknowledgement of amendments located on Page 18 of the Proposal as acknowledgement of its receipt. If you have any questions, contact me at (919) 560-4326, Ext. 245.


Kyle R. Butler
Contract Administrator

Base Leveling Pad Notes:

1. The leveling pad is to be constructed of crushed stone or 3,000 psi± unreinforced concrete
2. The base foundation is to be approved by the site geotechnical engineer prior to placement of the leveling pad.


Standard Unit	
Width:	18"
*Depth:	18"
Height:	8"
*Weight:	102 lbs

Cap Unit	
Width:	18"
*Depth:	10 1/2"
Height:	4"
*Weight:	45 lbs

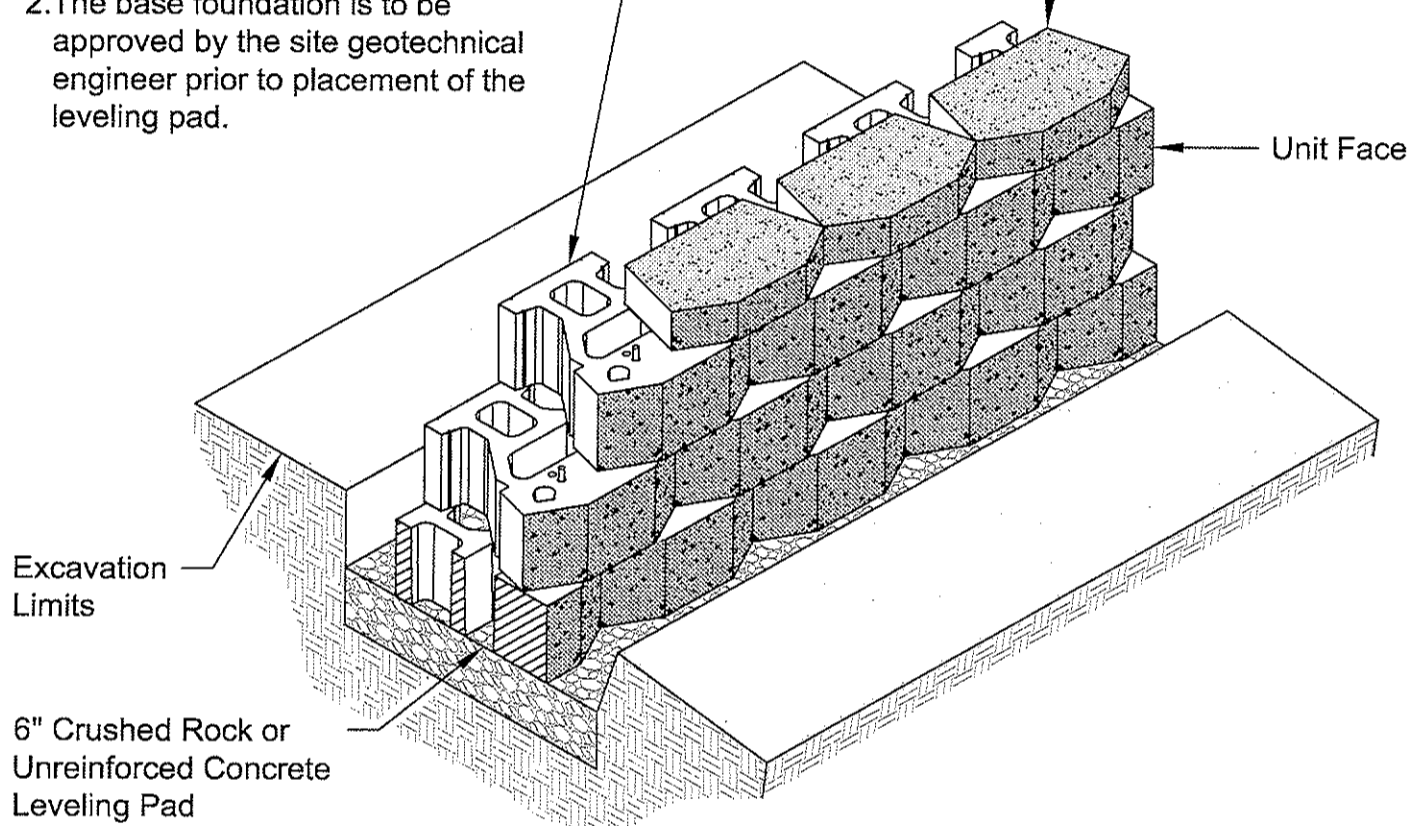

Standard Unit/Base Pad Isometric Section View

* Dimensions & Weight May Vary by Region

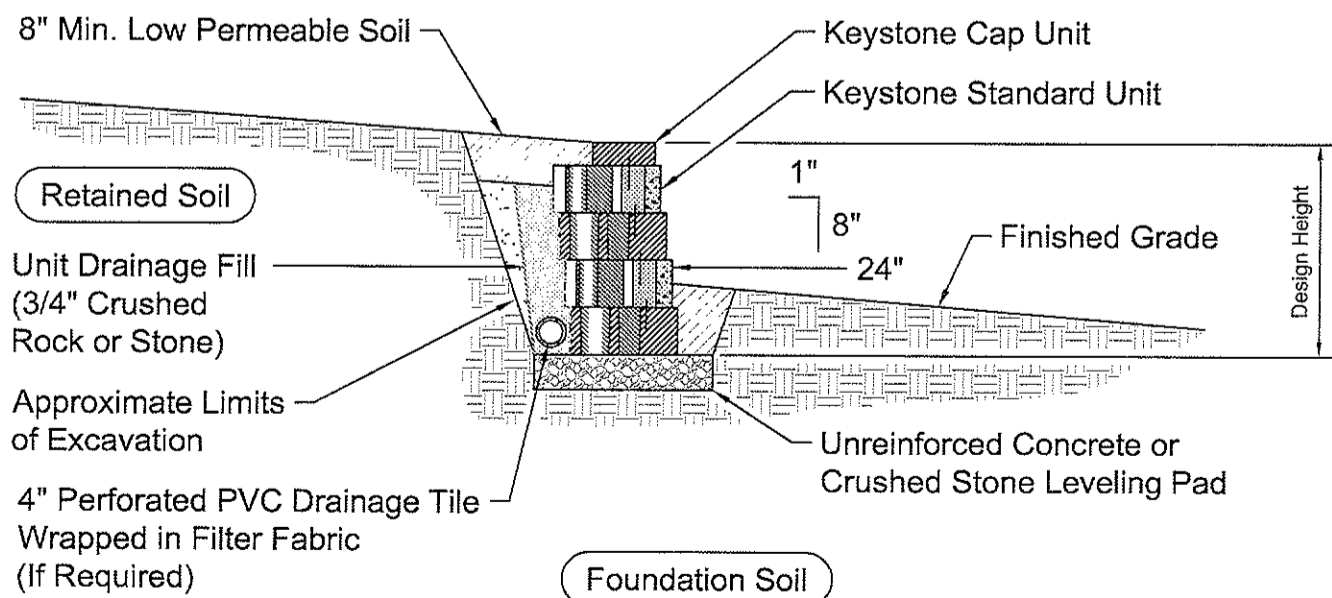

Typical Gravity Wall Section

Standard Unit - 1" Setback