



SEE SHEET 1 OF 2
FOR CURB + GUTTER
TYPE / DIMENSIONS

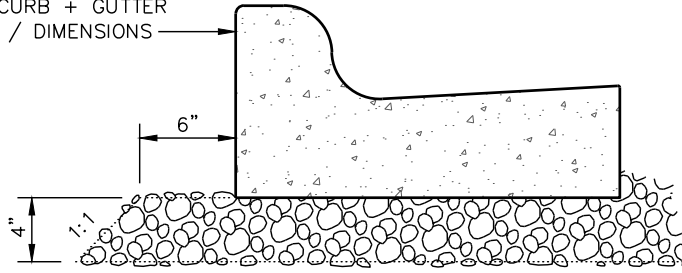

4" COMPACTED A.B.C.
UNDER ALL CURB + GUTTER

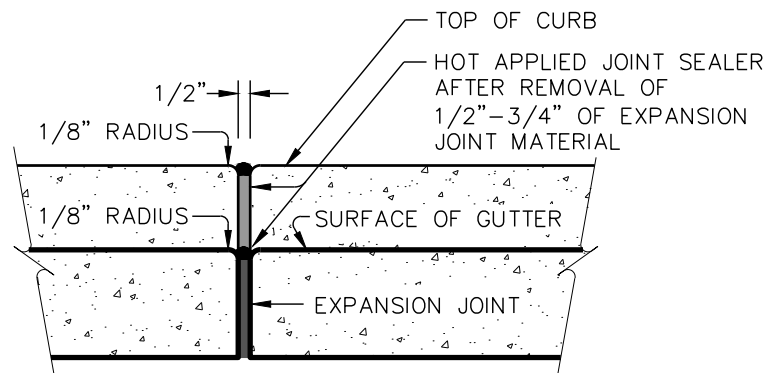

TRANSVERSE EXPANSION
JOINT IN CURB AND GUTTER

NOTES:

1. Use non-reinforced, air entrained, concrete with a minimum strength of 3000 lbs.
2. Contraction joints shall be placed at 10' intervals.
3. Contraction joints may be installed by the use of templates or formed by other approved methods. Where such joints are not formed by templates, a minimum depth of 1 1/2" shall be obtained.
4. All construction joints shall be filled with joint filler and hot applied joint sealer. See NCDOT specifications.
5. Expansion joints shall be spaced at 90' intervals, and adjacent to all rigid objects.

Details Provided by APPIAN Consulting Engineers - www.applanengineers.com



Dept. of Public Works
101 City Hall Plaza
Durham, NC 27701

CITY OF DURHAM, NC
USE WITH THE STANDARD SPECIFICATIONS ONLY

Voice (919) 560-4326

www.durhamnc.gov

**CONCRETE CURB
AND GUTTER**

SCALE:
Not to Scale

DETAIL#
402.01

REVISION DATE:
06/2017

SHEET#
2 of 2