


Details Provided by APPIAN Consulting Engineers - www.appianengineers.com

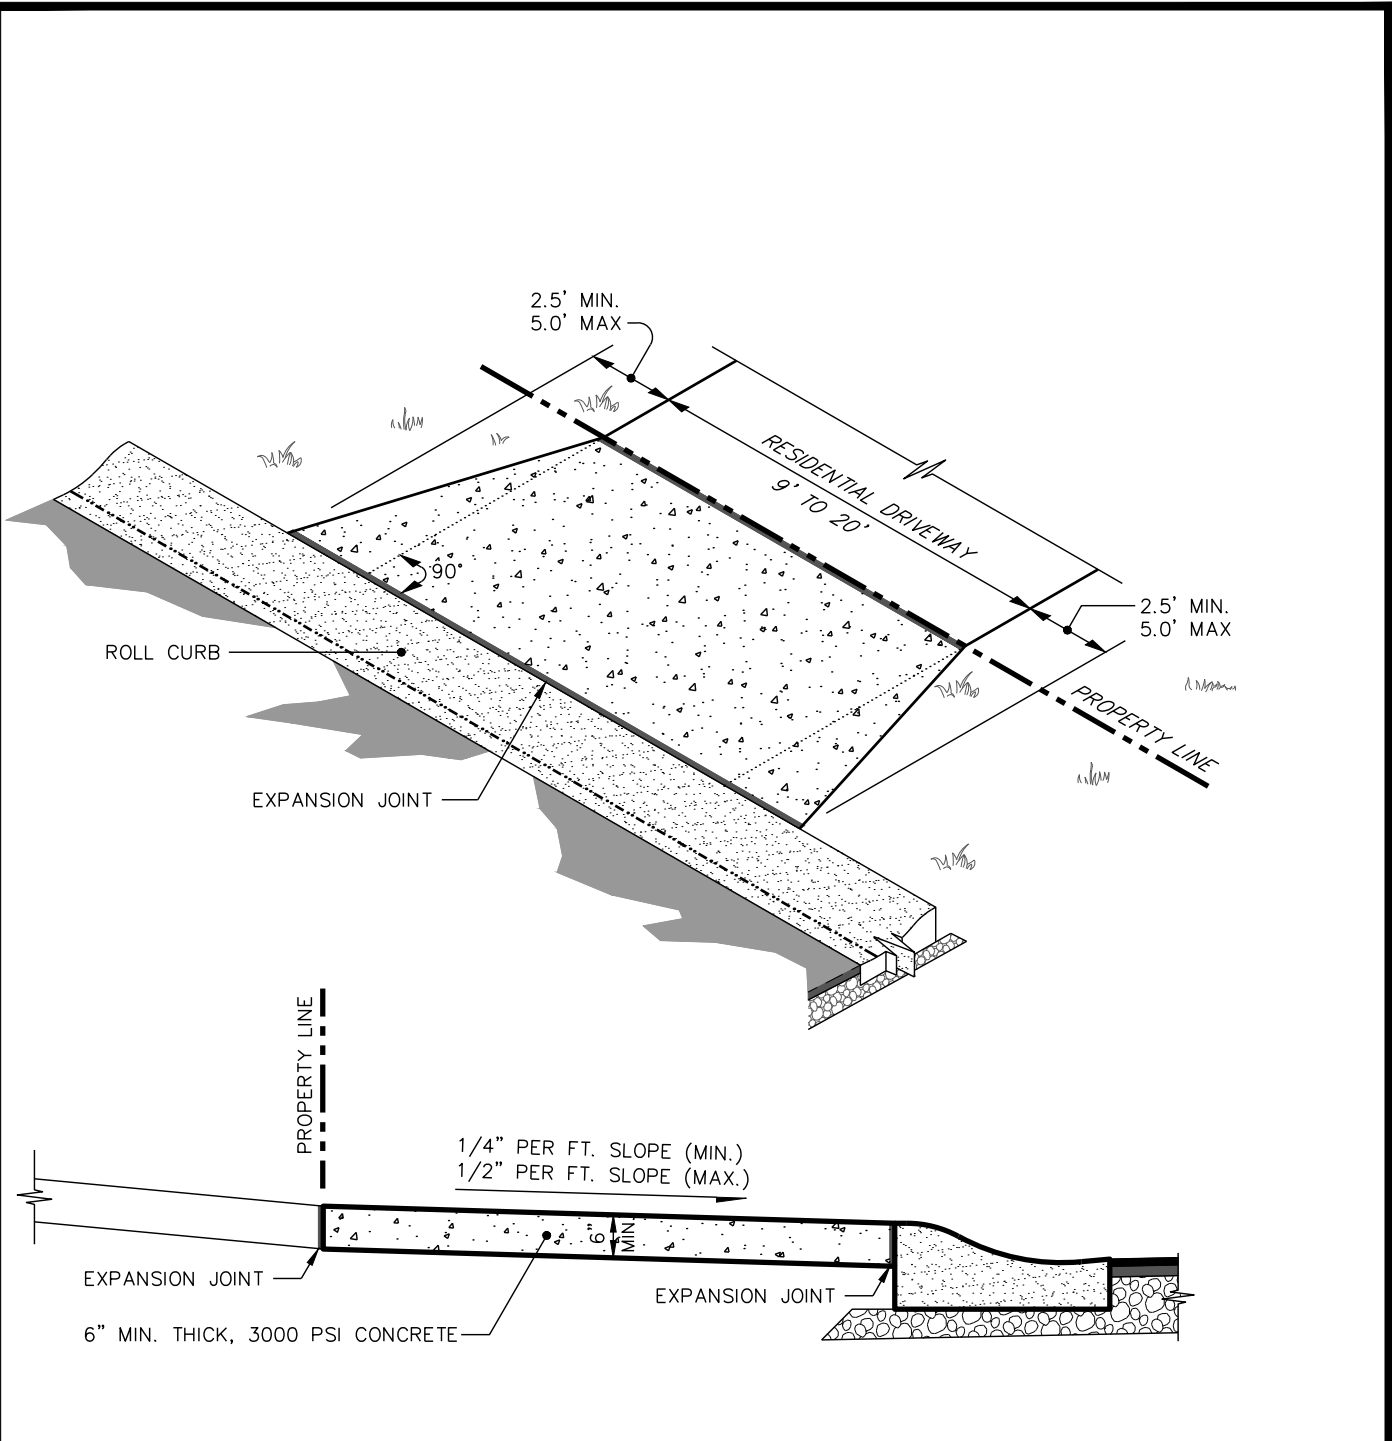

**NOTES:**

1. Curb and gutter section will be poured continuous through the standard and alternate driveway with the face of curb dropped down as shown.
2. Driveway will be constructed after the curb forms have been removed.
3. Concrete shall be non-reinforced, air-entrained with a minimum strength of 3000 lbs.

 <p><b>CITY OF DURHAM</b></p>	<p>Dept. of Public Works 101 City Hall Plaza Durham, NC 27701</p>	<p><b>CITY OF DURHAM, NC</b> USE WITH THE STANDARD SPECIFICATIONS ONLY</p>	<p>Voice (919) 560-4326 <a href="http://www.durhamnc.gov">www.durhamnc.gov</a></p>			
	<p><b>DRIVEWAY FOR ROLL CURB STREET SECTION (RESIDENTIAL)</b></p>		<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%;">SCALE: Not to Scale</td> <td style="width: 50%;">DETAIL# 404.04</td> </tr> <tr> <td>REVISION DATE: 06/2020</td> <td>SHEET# 1 of 1</td> </tr> </table>	SCALE: Not to Scale	DETAIL# 404.04	REVISION DATE: 06/2020
SCALE: Not to Scale	DETAIL# 404.04					
REVISION DATE: 06/2020	SHEET# 1 of 1					