


Details Provided by APPIAN Consulting Engineers - www.appianengineers.com



NOTES:

1. The minimum amount of pipe to be installed in a street ditch for a driveway is 20'
 2. May be 25' if drive serves a double garage, subject to approval of the city engineer.
 3. Radius of drive entrance may be the width of sidewalk area (distance from face of curb to p/i) minus 5'. However, in no case shall the radius exceed 4'-5".
- * Dimension measured along curb line and curb line projection.

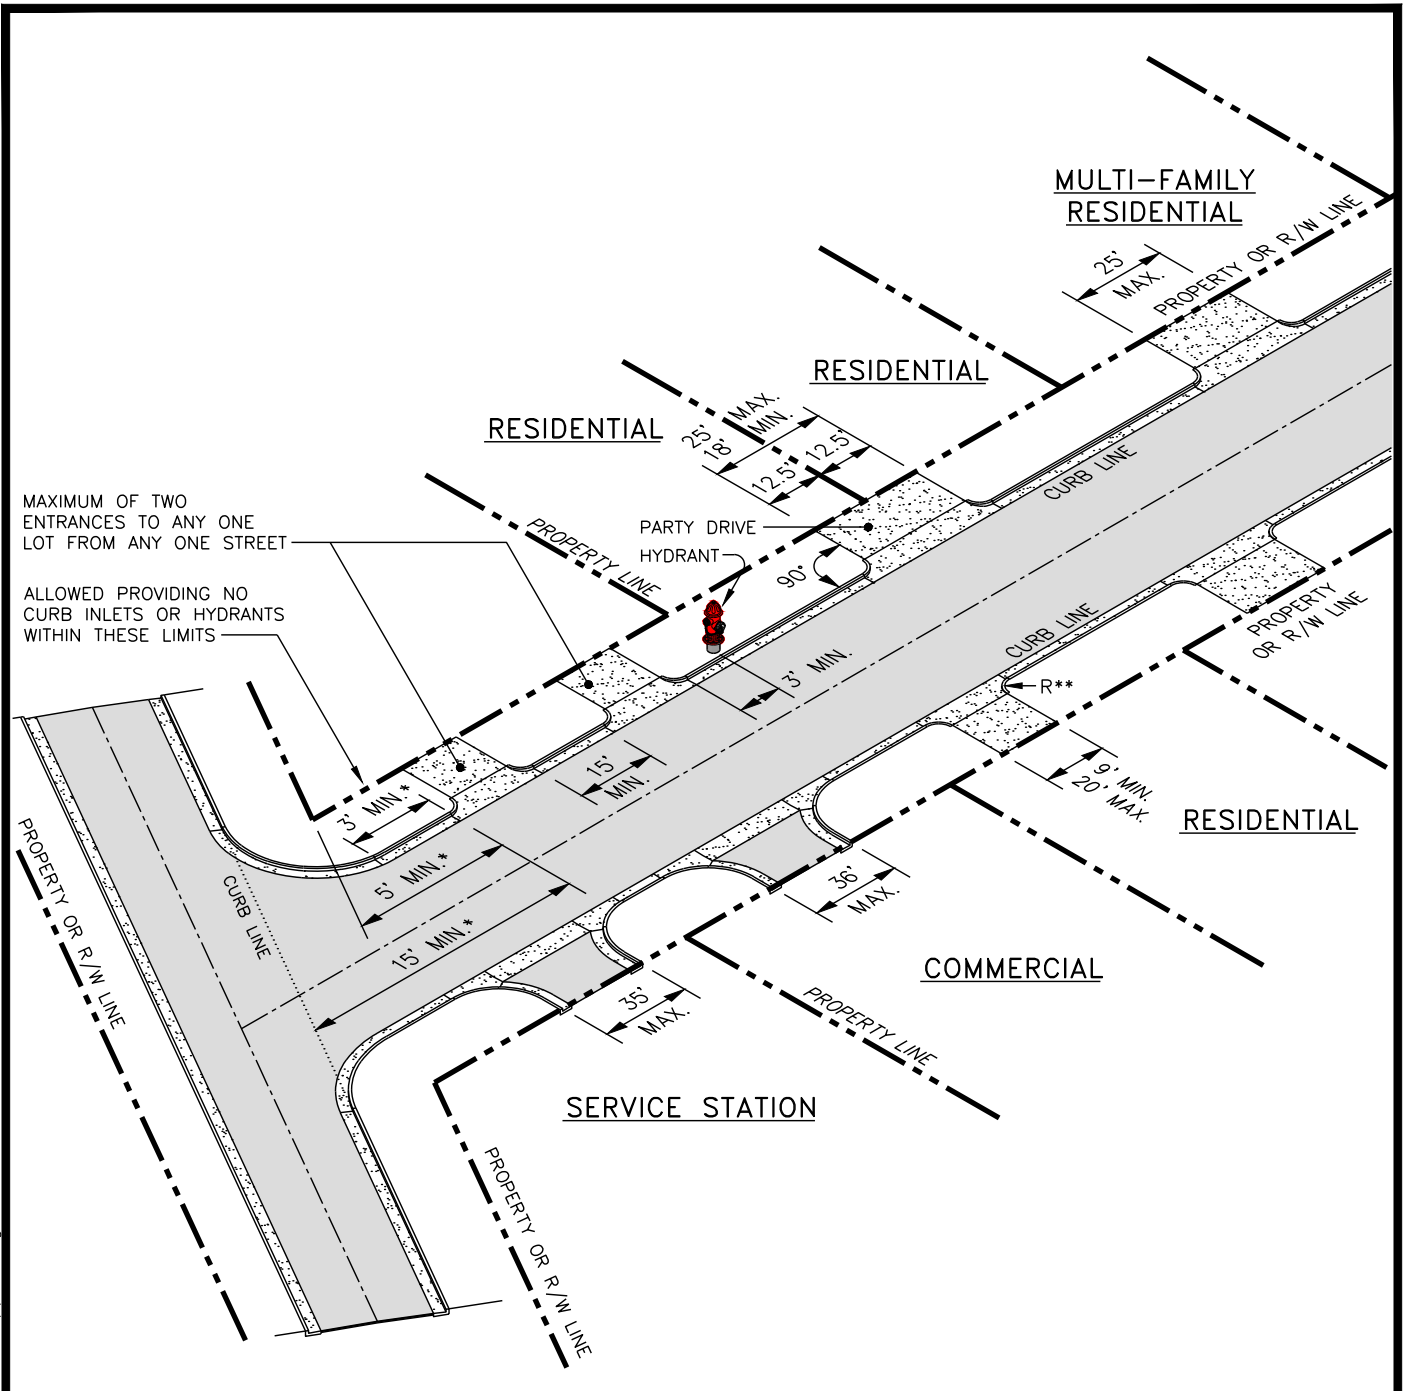

Dept. of Public Works
101 City Hall Plaza
Durham, NC 27701

CITY OF DURHAM, NC
USE WITH THE STANDARD SPECIFICATIONS ONLY

Voice (919) 560-4326
www.durhamnc.gov

**DRIVEWAY
ORDINANCE**

SCALE: Not to Scale	DETAIL# 404.06
REVISION DATE: 06/2017	SHEET# 1 of 1