


BROOM FINISH CONCRETE SURFACE AREA INSIDE OF TOOLED EDGE TO CREATE PICTURE FRAME EFFECT

HEAVY DUTY DRIVEWAY

1/2" EXPANSION JOINT WHEN ABUTTING CONC. DRIVEWAY

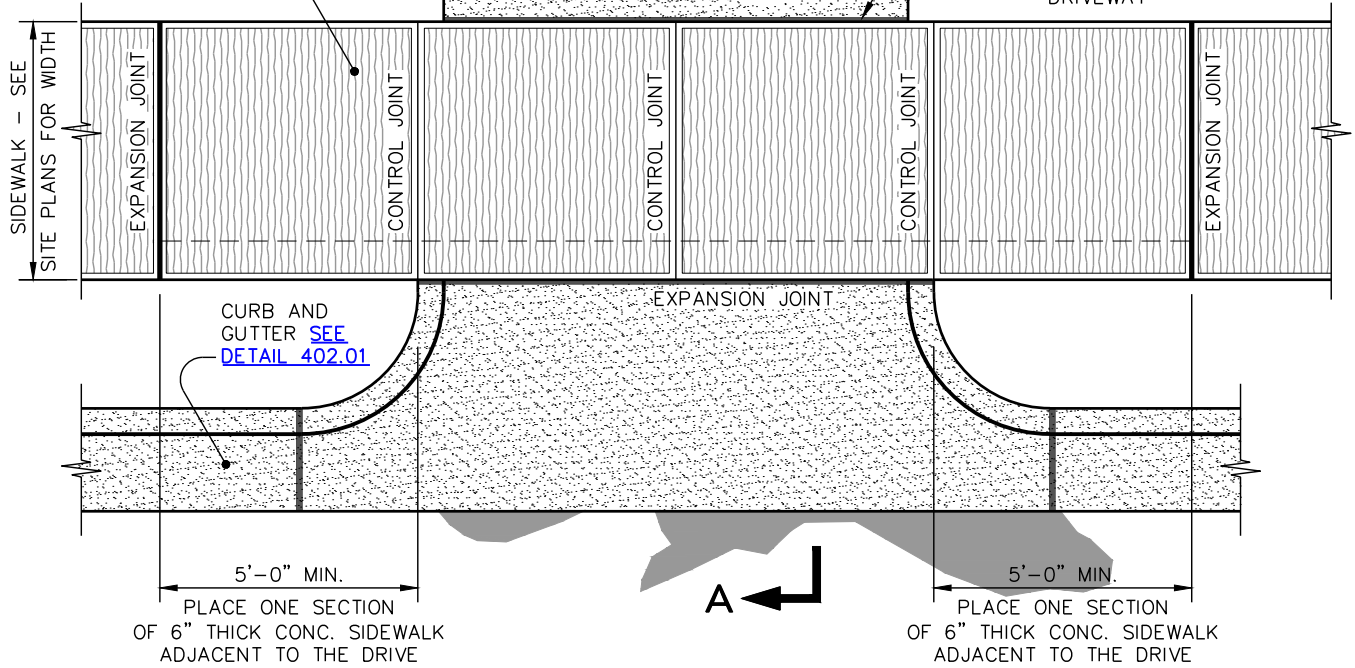


EXPANSION JOINT (BETWEEN CONC. SUB SLAB AND CURB)

CONCRETE DRIVEWAY APRON SEE DETAIL 404.02

CURB AND GUTTER SEE DETAIL 402.01

ADJACENT ASPHALT ROADWAY

VARIES - SEE PLANS FOR LENGTH AND SCORING PATTERN

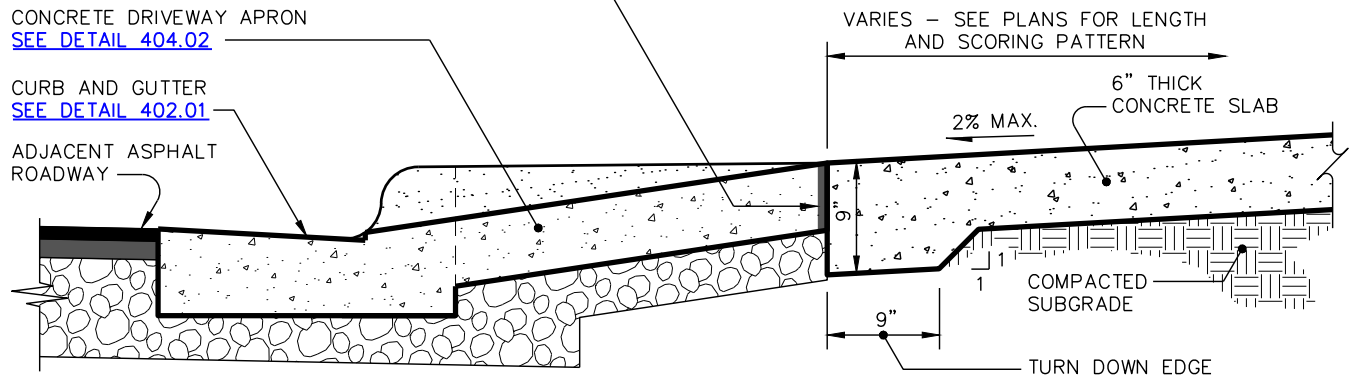

SECTION A-A

NOTES:

1. All concrete is to be minimum 3,000 psi at 28 days, unless otherwise noted on the plans.

Details Provided by APPIAN Consulting Engineers - www.applanengineers.com



Dept. of Public Works
101 City Hall Plaza
Durham, NC 27701

CITY OF DURHAM, NC
USE WITH THE STANDARD SPECIFICATIONS ONLY

Voice (919) 560-4326

www.durhamnc.gov

**HEAVY DUTY CONCRETE WALKWAY AT
CONCRETE DRIVEWAY APRONS DOWNTOWN
STREETScape DETAILS**

SCALE:
Not to Scale

DETAIL#
406.02

REVISION DATE:
06/2017

SHEET#
1 of 1