



BROOM FINISH CONCRETE SURFACE AREA INSIDE OF SMOOTH TOOLED EDGE TO CREATE PICTURE FRAME EFFECT

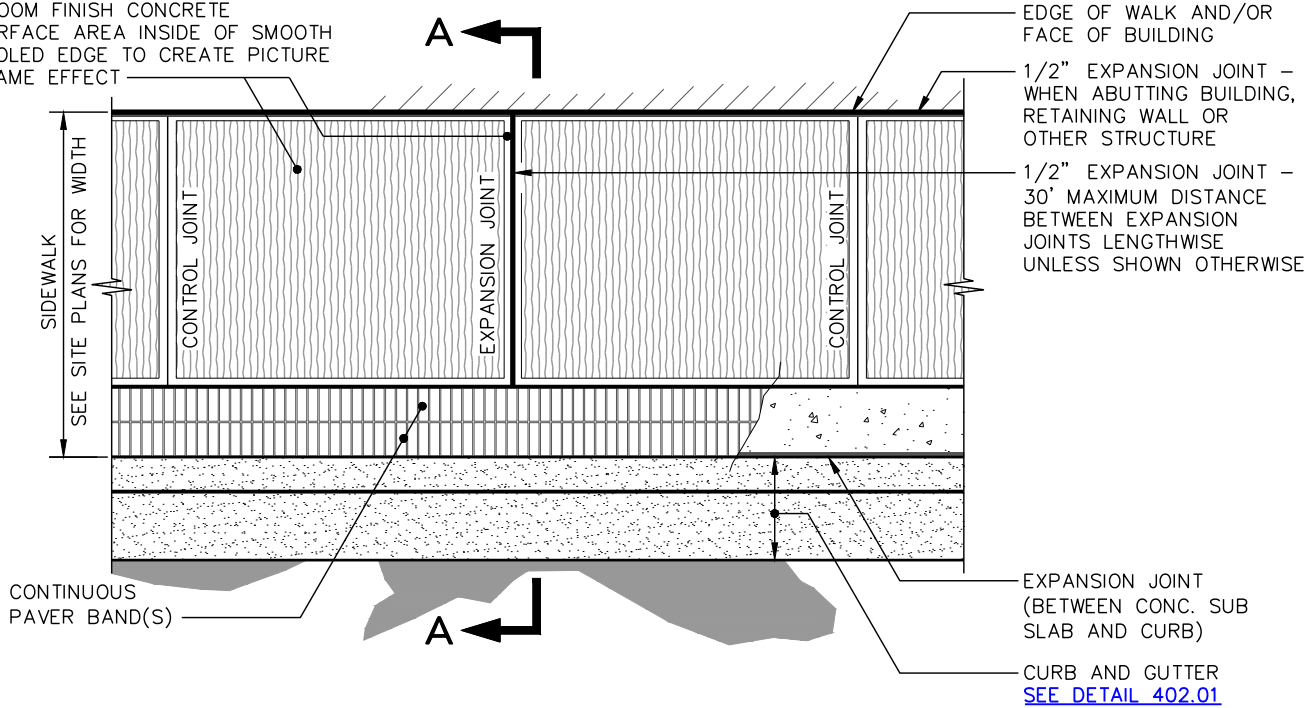

EXPANSION JOINT (BETWEEN CONC. SUB SLAB AND CURB)

CURB AND GUTTER
[SEE DETAIL 402.01](#)

ADJACENT ASPHALT ROADWAY

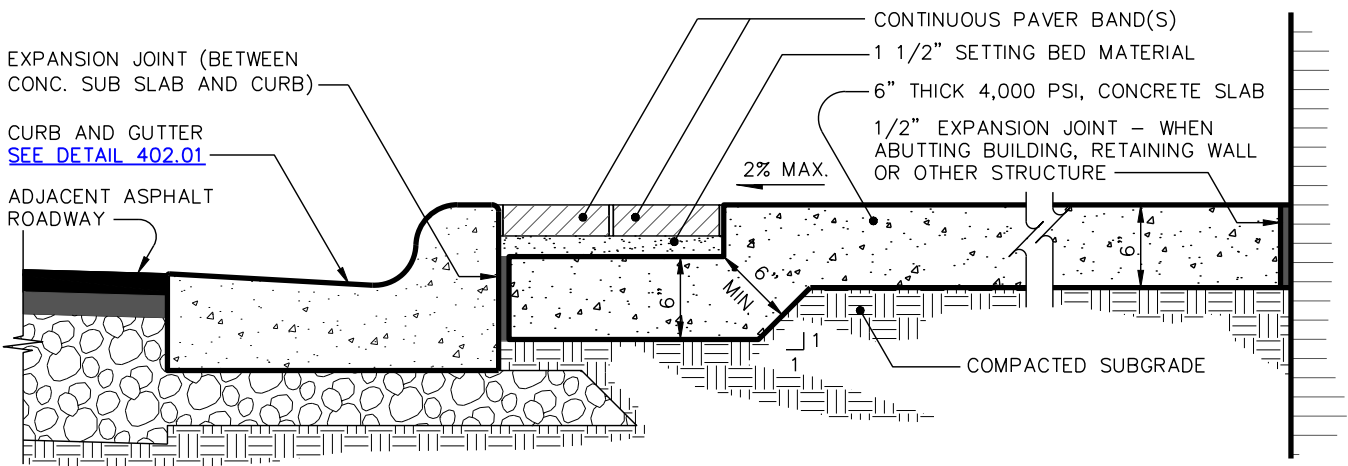

NOTES:

1. All concrete is to be minimum 3,000 psi at 28 days, unless otherwise noted on the plans.
2. Pedestrian/Light Traffic brick shall conform to ASTM C902-95. Minimum compressive strength 8,000 psi. Maximum cold water absorption 8%. Maximum abrasion index 0.11. Brick dimensions and pattern to match existing brick pavers at the site.
3. Bedding sand should be washed free from deleterious or foreign materials, well graded, angular, concrete sand conforming to ASTM C33. Spaces between brick pavers shall be filled with washed jointing sand with cement or polymer sand per ASTM C144.

Details Provided by APPIAN Consulting Engineers - www.applanengineers.com



Dept. of Public Works
101 City Hall Plaza
Durham, NC 27701

CITY OF DURHAM, NC
USE WITH THE STANDARD SPECIFICATIONS ONLY

Voice (919) 560-4326
www.durhamnc.gov

CONC WALKWAY W/ PAVER BAND AT CURB DOWNTOWN STREETScape DETAILS

SCALE: Not to Scale	DETAIL# 406.04
REVISION DATE: 06/2017	SHEET# 1 of 1